


$$W_F = 37,826\#$$

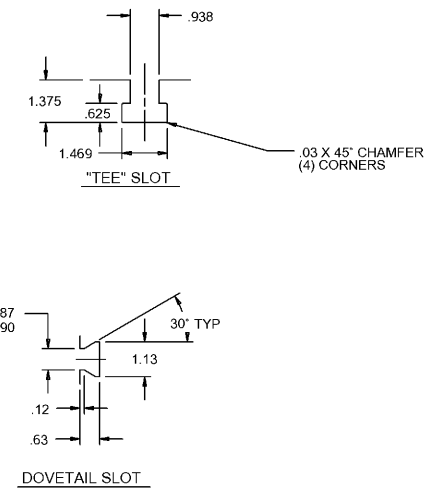

THICKNESS IS BASED ON 4000 PSI
CONCRETE REINFORCED WITH STEEL
TO AT LEAST THE EXTENT OF 1/5
OF ONE PERCENT OF THE CROSS
SECTIONAL AREA OF CONCRETE.
IT IS THE MINIMUM THICKNESS
PERMISSIBLE. ACTUAL DIMENSIONS
ARE DEPENDENT ON LOCAL SOIL
CONDITIONS. CONSULT A LOCAL
CIVIL ENGINEER.

16" CLOSED HEIGHT